
MARATHON COUNTY SHERIFF'S DEPARTMENT STORAGE BUILDING RENOVATION

MARATHON COUNTY



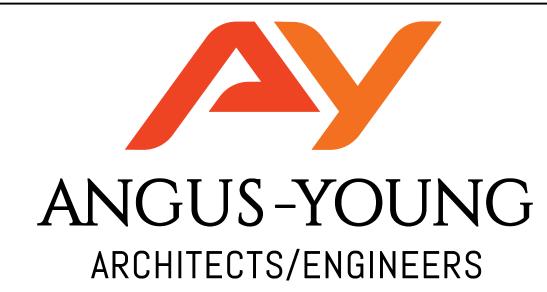

Janesville | Madison


MARATHON COUNTY SHERIFF'S DEPARTMENT STORAGE BUILDING RENOVATION

AY PROJECT NUMBER: 77082

REGULATORY DATA:

USE AND OCCUPANCY CLASSIFICATION

7015 PACKER DRIVE WAUSAU, WI, 54401

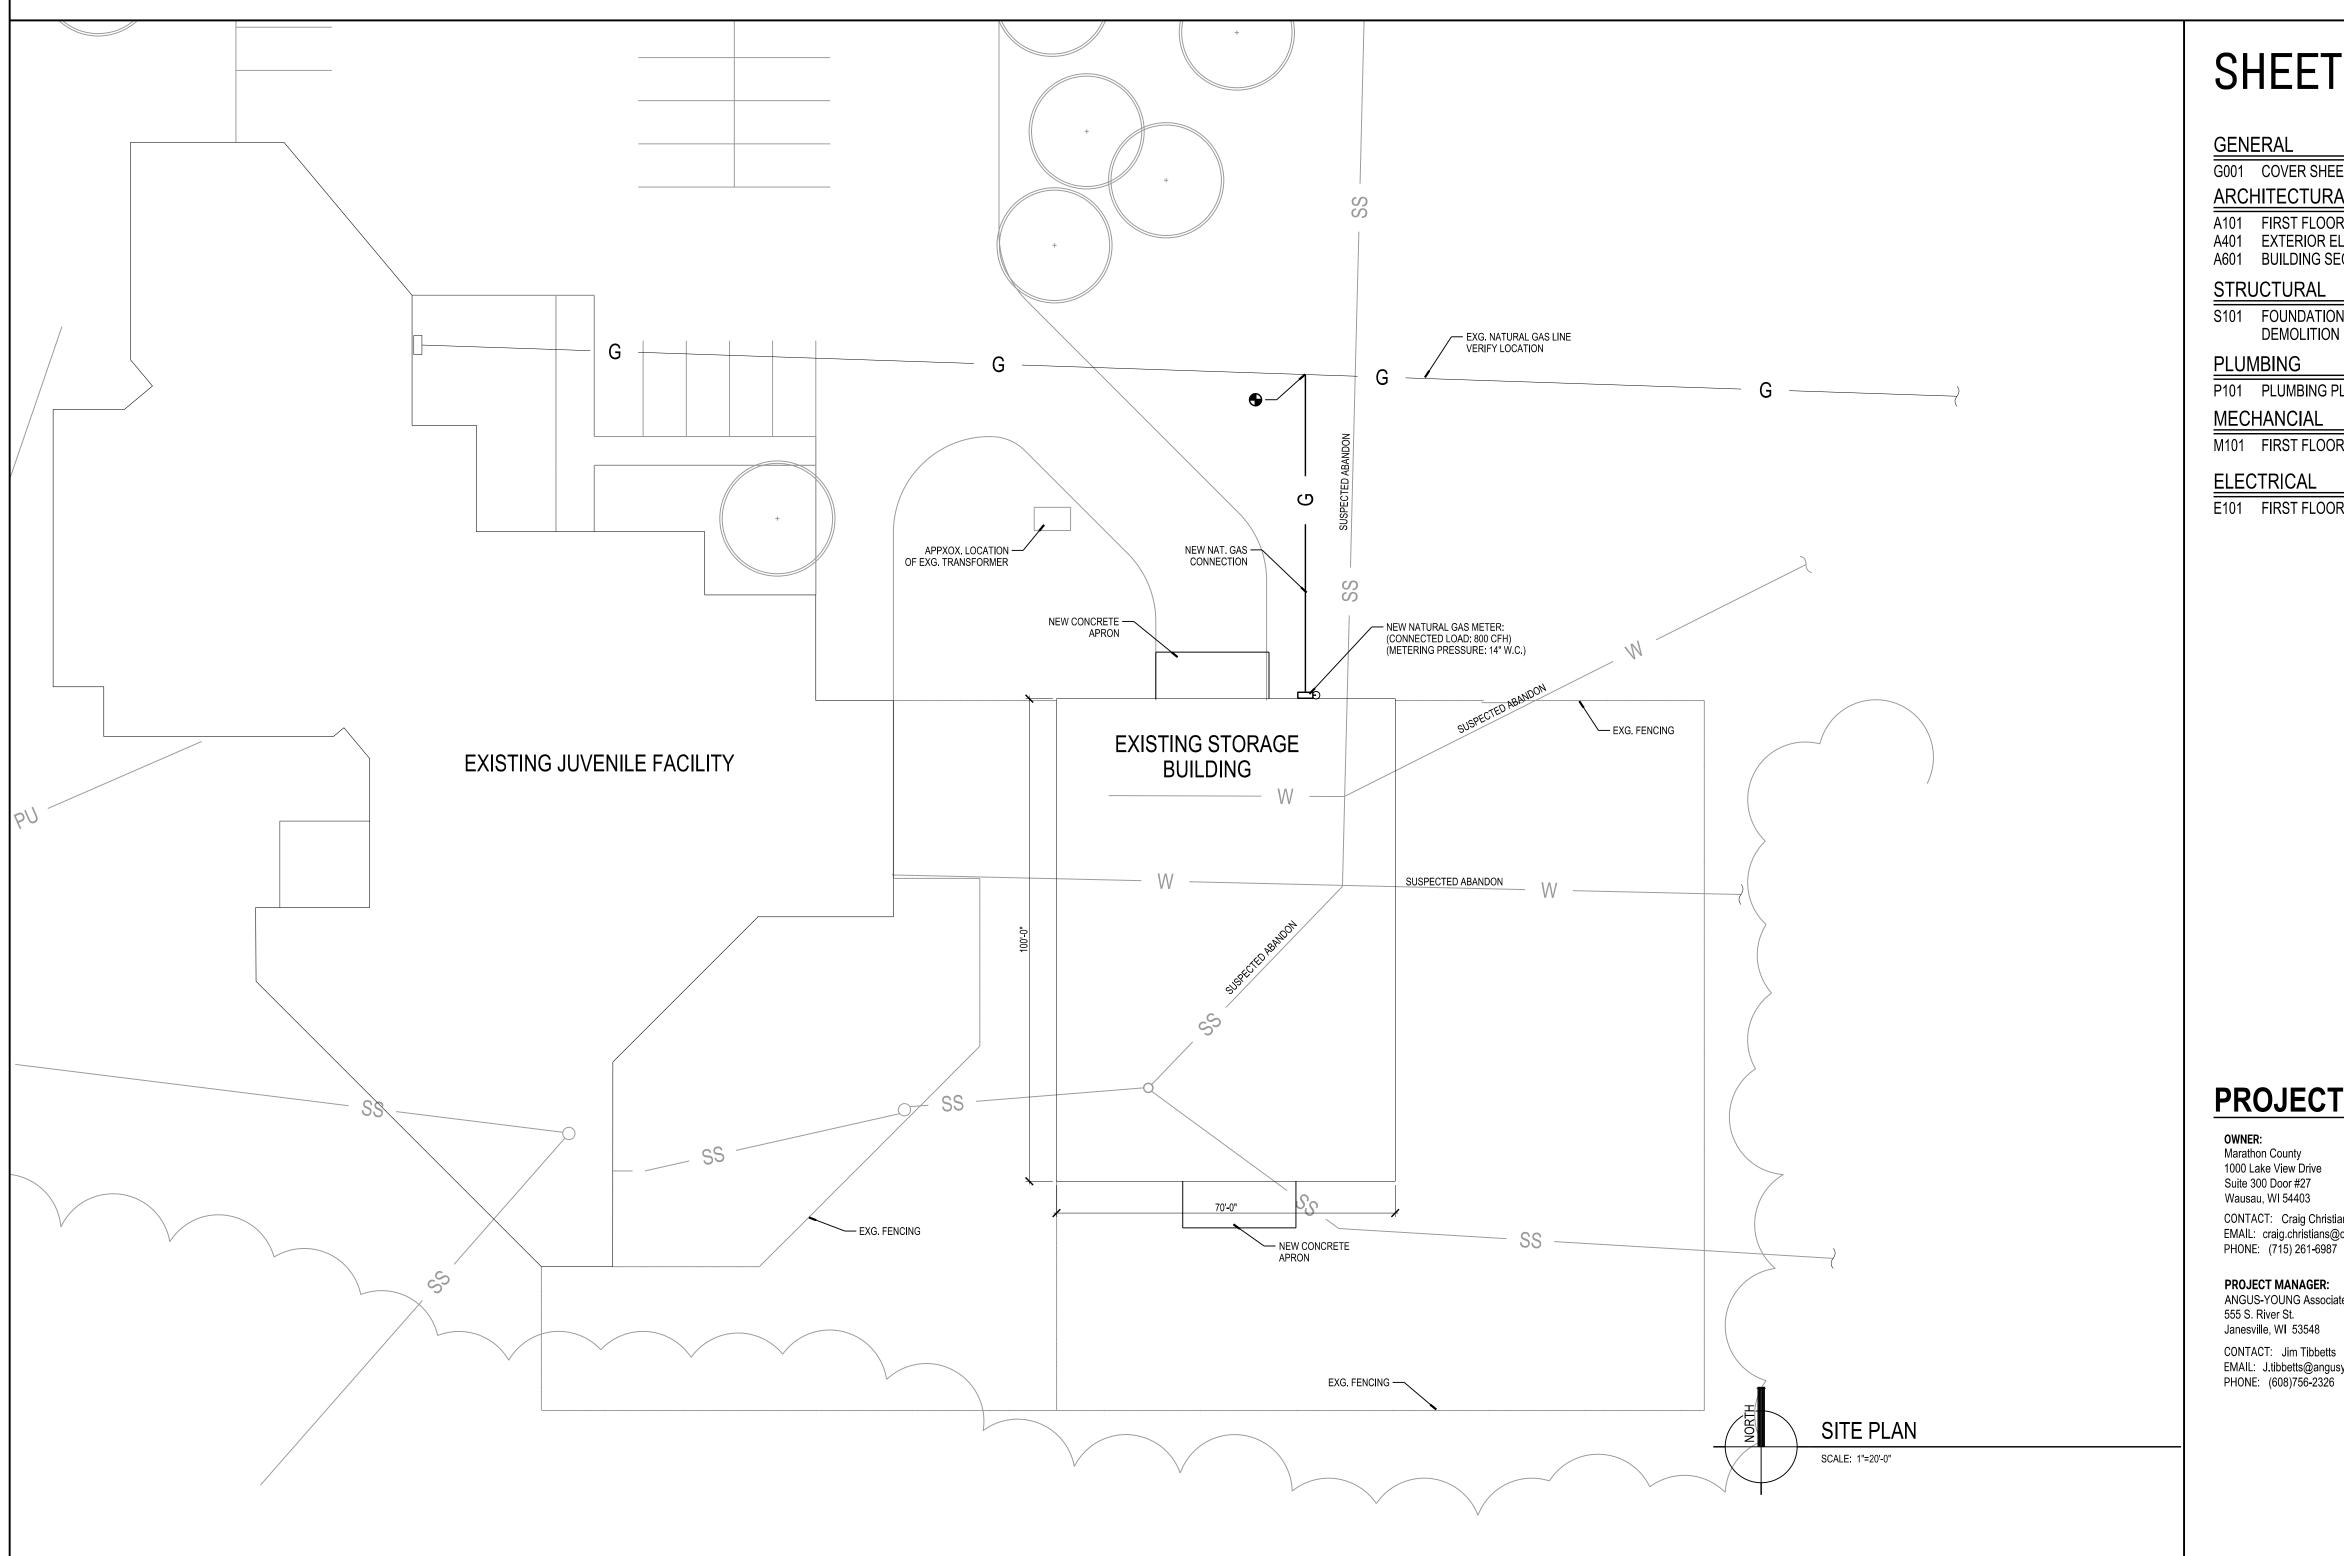

SHEET INDEX:

G001 COVER SHEET, REGULATORY INDEX

ARCHITECTURAL

A101 FIRST FLOOR PLAN NEW AND FIRST FLOOR DEMOLITION PLAN. A401 EXTERIOR ELEVATIONS AND DETAILS

A601 BUILDING SECTION

STRUCTURAL

S101 FOUNDATION SLAB PLAN NEW, FOUNDATION SLAB DEMOLITION PLAN, AND DETAILS.

P101 PLUMBING PLAN & DETAILS

MECHANCIAL

M101 FIRST FLOOR NEW AND DEMOLITION MECHANICAL PLAN

E101 FIRST FLOOR NEW AND DEMOLITION ELECTRICAL PLAN

GROUP S2: Storage Building Area: 7,000 Sq.Ft. Occupant Load: 14

TYPE OF CONSTRUCTION

2015 International Building Code

PROJECT ADDRESS

7015 PACKER DRIVE WAUSAU, WI, 54401

BUILDING CODE

TYPE 5B Construction Non-Sprinklered Building

PROJECT TEAM

Marathon County 1000 Lake View Drive Suite 300 Door #27 Wausau, WI 54403 CONTACT: Craig Christians EMAIL: craig.christians@co.marathon.wi.us PHONE: (715) 261-6987

PROJECT MANAGER: ANGUS-YOUNG Associates, Inc. 555 S. River St. Janesville, WI 53548 CONTACT: Jim Tibbetts EMAIL: J.tibbetts@angusyoung.com

1 Preliminary Review Set 20240111 2 Bid Review Set 20240129 3 Bidding / Construction 20240215	NO:	DESCRIPTION:	DATE:
	1	Preliminary Review Set	20240111
3 Bidding / Construction 20240215	2	Bid Review Set	20240129
	3	Bidding / Construction	20240215

Due to electronic distribution, this drawing may not be printed to the scale indicated on the drawings. Do NOT use scale to determine dimensions or sizes.

No part of this drawing may be used or reproduced in any form or by any means, or stored in a database or retrieval system, without prior written permission of.

ANGUS - YOUNG ASSOCIATES, INC.

Copyright © 2020 All Rights Reserved 608.756.2326

24 | 20 | 16 | 12 | 08 | 04 23 | 19 | 15 | 11 | 07 | 03 22 | 18 | 14 | 10 | 06 | 02 21 | 17 | 13 | 09 | 05 | 01

DETAILS IN THIS SET ARE PLACED ON THE SHEETS AND NUMBERED WITH RESPECT TO THE GRID ABOVE. CONSEQUENTLY, DETAILS ON A GIVEN SHEET MAY OR MAY NOT BE NUMBERED CONSECUTIVELY.

COVER SHEET

www.angusyoung.com



MARATHON COUNTY

SHERIFF'S DEPARTMENT STORAGE BUILDING

> 7015 PACKER DRIVE WAUSAU, WI 54401



	ISSUANCES / REVISIONS	
:	DESCRIPTION:	DATE:
•	Preliminary Floor Plan	20240111
	Bid Review Set	20240129
	Bidding / Construction	20240215
_		
	P:13 PM 02/14/20 Due to electronic distribution, this drawing not be printed to the scale indicated of drawings. Do NOT use scale to deterring dimensions or sizes.	ng may n the
	No part of this drawing may be used reproduced in any form or by any mean stored in a database or retrieval syst	ns, or

stored in a database or retrieval system, without prior written permission of. ANGUS - YOUNG ASSOCIATES, INC. Copyright © 2023 All Rights Reserved

PROJECT NUMBER

77082 APPROVED BY

CAC

REVIEWED BY

DRAWN BY

FIRST FLOOR PLAN NEW

ANGUS-YOUNG ARCHITECTS/ENGINEERS Janesville | Madison

DEPARTMENT STORAGE BUILDING



	ISSUANCES / REVISIONS	
NO:	DESCRIPTION:	DATE:
1	Preliminary Floor Plan	20240111
2	Bid Review Set	20240129
3	Bidding / Construction	20240215
	Due to electronic distribution, this drawin not be printed to the scale indicated on drawings. Do NOT use scale to determ dimensions or sizes.	g may the

without prior written permission of.



MARATHON COUNTY

SHERIFF'S DEPARTMENT STORAGE BUILDING

7015 PACKER DRIVE WAUSAU, WI 54401



	ISSUANCES / REVISIONS								
NO:	DESCRIPTION:	DATE:							
1	Preliminary Floor Plan	20240111							
2	Bid Review Set	20240129							
3	Bidding / Construction	20240215							
	9:14 PM 02/14/202-								
	Due to electronic distribution, this drawing may not be printed to the scale indicated on the drawings. Do NOT use scale to determine								

dimensions or sizes.

No part of this drawing may be used or reproduced in any form or by any means, or stored in a database or retrieval system, without prior written permission of. ANGUS - YOUNG ASSOCIATES, INC. Copyright © 2023 All Rights Reserved


> PROJECT NUMBER 77082

APPROVED BY

CAC REVIEWED BY JCT

DRAWN BY RAV

BUILDING SECTION

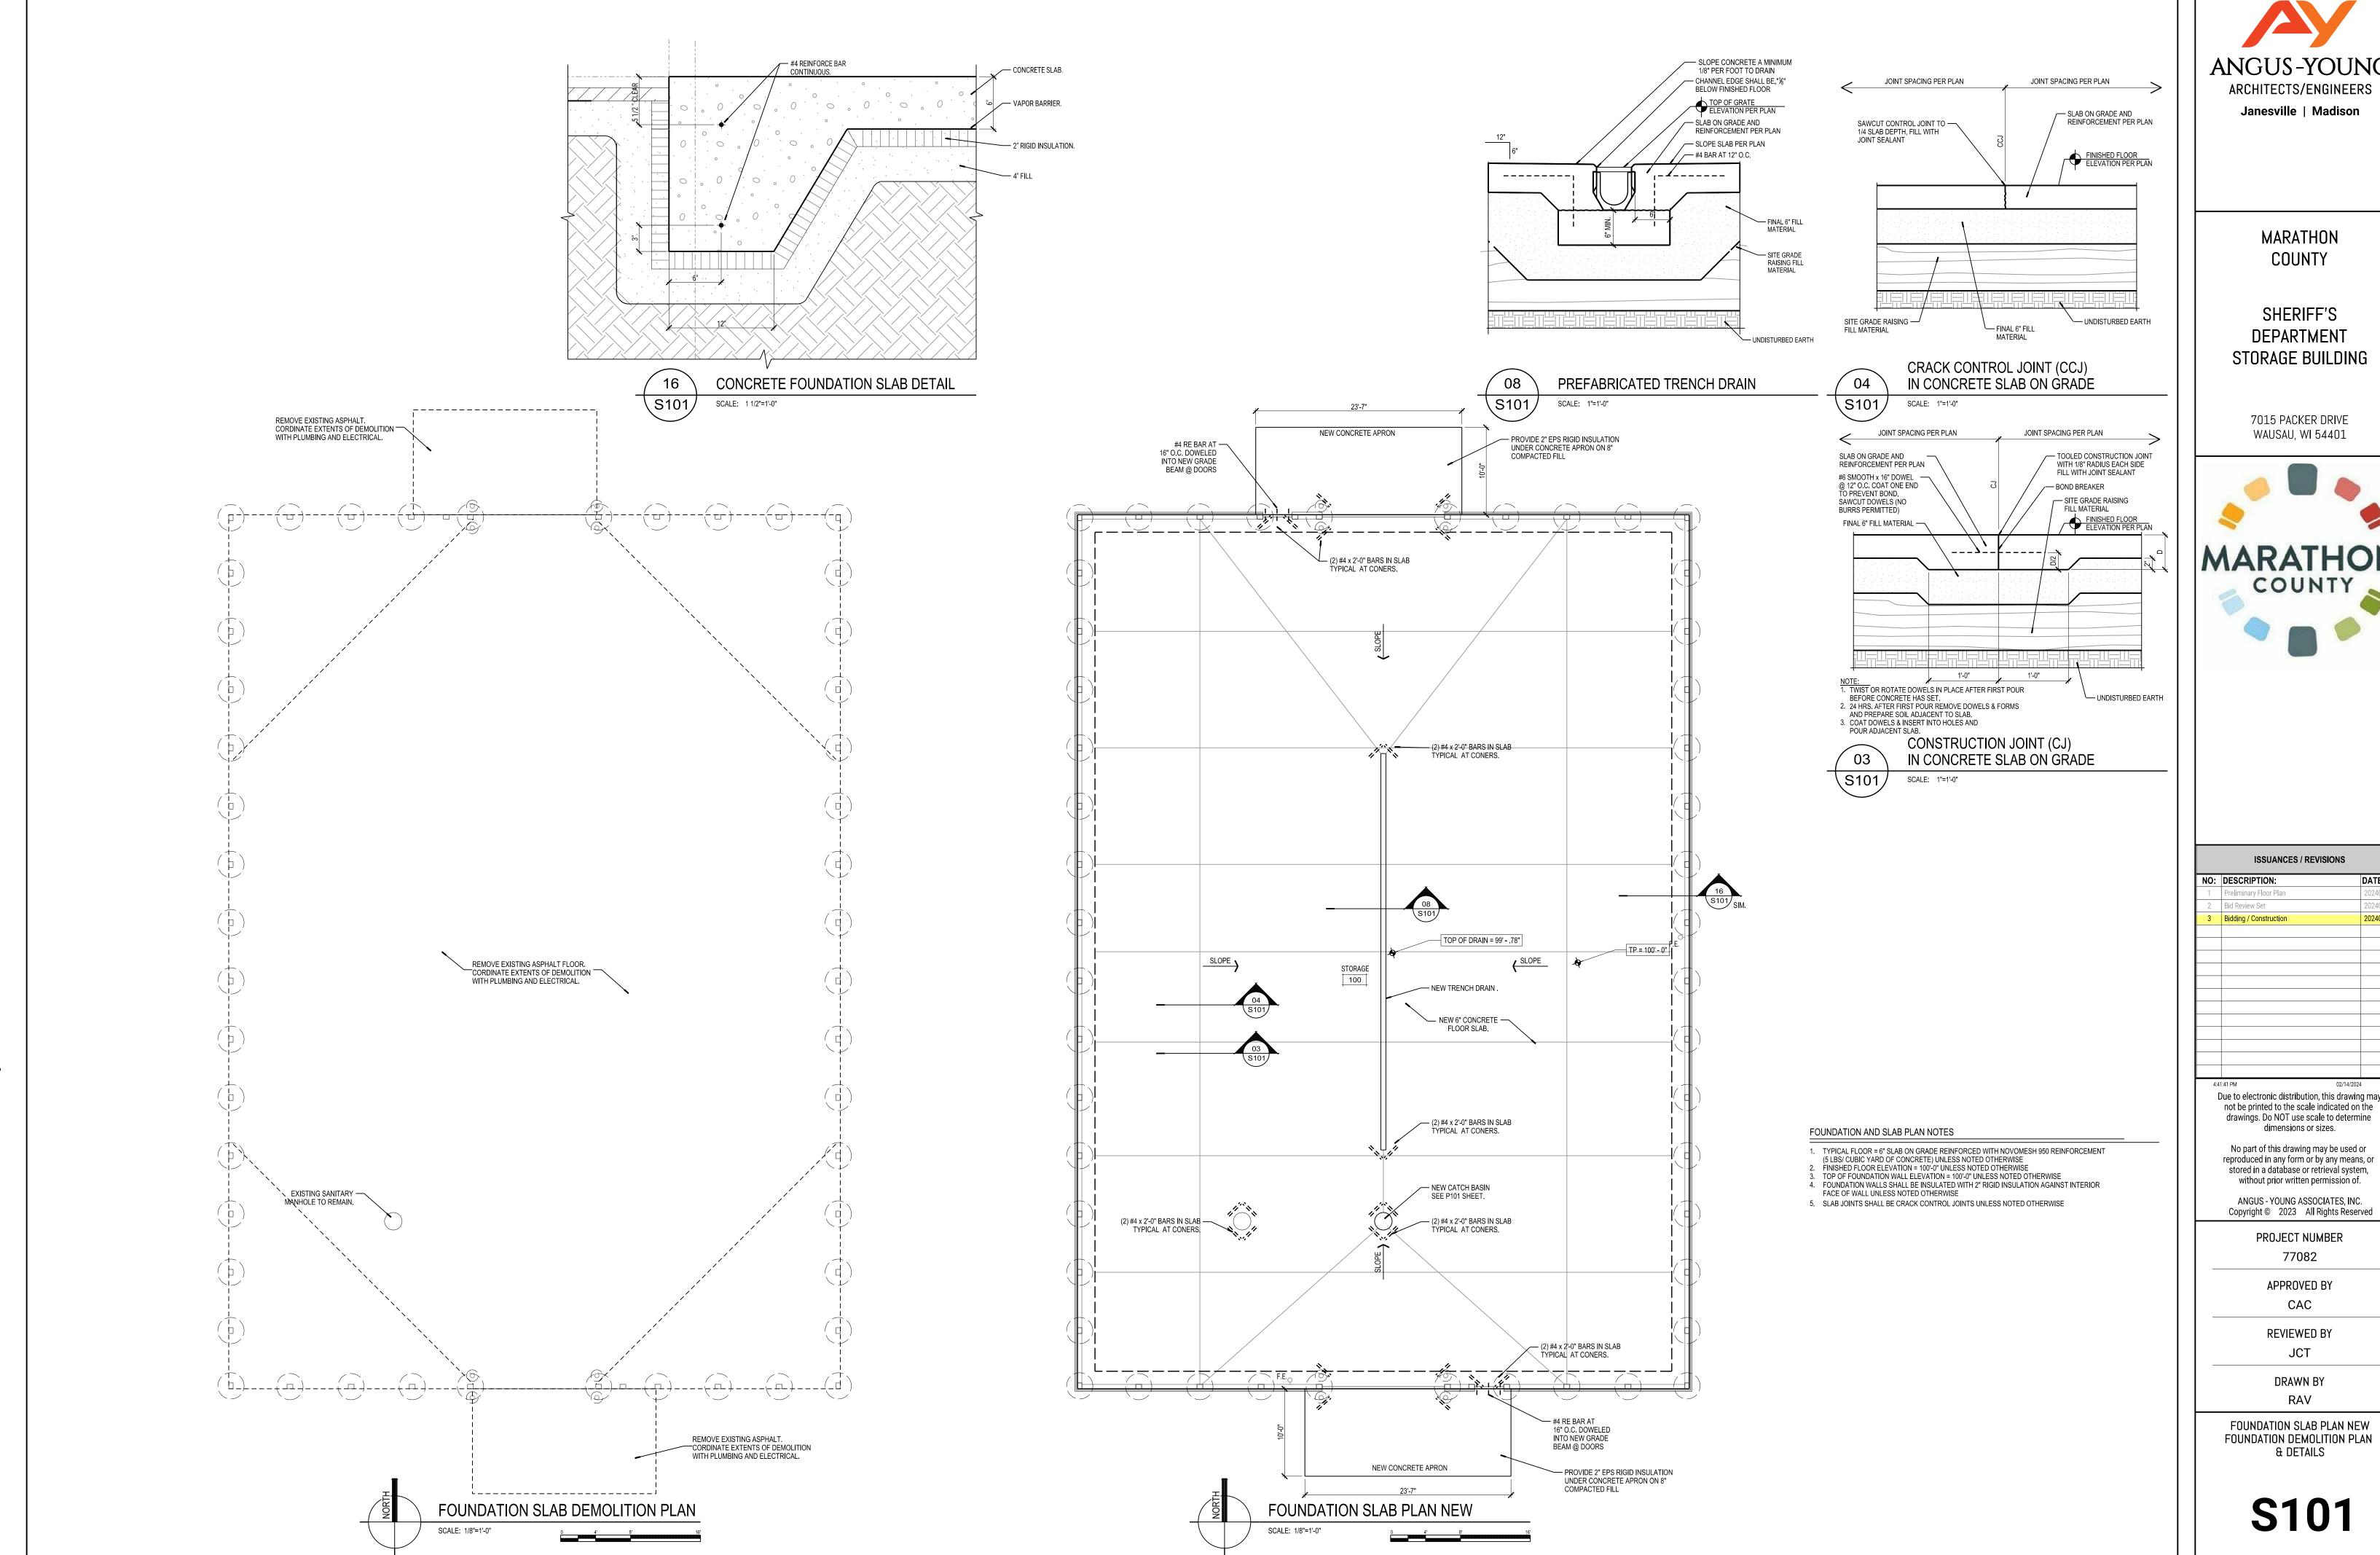

ARCHITECTS/ENGINEERS Janesville | Madison

MARATHON

SHERIFF'S DEPARTMENT STORAGE BUILDING

7015 PACKER DRIVE



ISSUANCES / REVISIONS 20240215 Due to electronic distribution, this drawing may

No part of this drawing may be used or reproduced in any form or by any means, or stored in a database or retrieval system, without prior written permission of.

Copyright © 2023 All Rights Reserved

PROJECT NUMBER

APPROVED BY

FOUNDATION SLAB PLAN NEW FOUNDATION DEMOLITION PLAN

FLOOR CLEANOUT

GARAGE CATCH BASIN FOR FIXTURES WITHOUT TRAPS

SECURE HEAVY DUTY
10 TON LIVE LOAD CAPACITY

NICKLE & BRONZE TOP

- CLEANOUT PLUG

— OPTIONAL: LONG RADIUS 90 DEGREE SWEEP

DEPENDING ON LOCATION

MAY BE USED IN LIEU OF WYE AND 1/8 BEND

DRAIN OR SEWER

CAST IRON PIPE IN CATCH BASIN

2" VENT ROUTED PER PLANS. TAKE OFF FROM TOP QUADRANT OF DRAIN PIPE

WATER TIGHT SEAL EQUAL TO RESSEAL OR KOR N SEAL —

NOTE: MINIMUM SIZE OF CATCH BASIN = 36" DIAMETER X 48" DEPTH

SCALE: 1"=1'-0"

DRAIN OR SEWER

FLOOR CLEANOUT


OUTLET PER PLANS —

TOP OF RIM ELEV SEE PLANS

> ---2" TO 6" GRADE RINGS AS REQUIRED

2" ABOVE WATER LINE

—ASTM C478 RISER SECTION W/ 5" THICK WALLS AND MODIFIED GROOVE JOINTS W/ RUBBER O-RING GASKETS

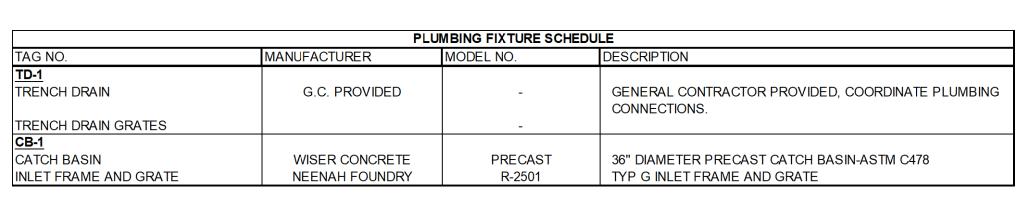

GENERAL NOTES

1. COORDINATE ALL PIPING WITH ELECTRICAL, MECHANICAL, AND FIRE PROTECTION CONTRACTORS.

3. ALL PIPING IN FINISHED AREAS SHALL BE CONCEALED ABOVE CEILINGS OR WITHIN WALLS.

5. INSTALL 3" AND LARGER DRAIN PIPE WITH MINIMUM PITCH OF 1/8" PER LINEAR FOOT.

6. INSTALL 2" AND SMALLER DRAIN PIPE WITH MINIMUM PITCH OF 1/4" PER LINEAR FOOT.

CODE SECTION 382.40(5)(B)3 AND APPLICABLE IECC REQUIREMENTS.

7. ALL SANITARY AND VENT PIPING SHALL BE PVC UNLESS OTHERWISE NOTED. ALL DOMESTIC WATER PIPING ABOVE GROUND SHALL BE TYPE L COPPER UNLESS OTHERWISE NOTED. ALL STORM PIPING SHALL BE SCH. 40 PVC UNLESS OTHERWISE NOTED.


8. PIPE MATERIAL AND VALVES MUST MEET ALL STANDARDS OF THE WISCONSIN PLUMBING CODE.

9. PLUMBING CONTRACTOR SHALL INSULATE ALL DOMESTIC WATER PIPING PER WISCONSIN PLUMBING

2. SUSPENDED PIPING AFF SHALL BE RUN TIGHT TO BOTTOM OF STRUCTURE WHERE POSSIBLE. ALL PIPING IN THE PLUMBING SYSTEM SHALL BE SUPPORTED IN ACCORDANCE WITH THE PROVISIONS OF CHAPTER 382,60 OF THE WISCONSIN PLUMBING CODE. PLUMBING CONTRACTOR TO COORDINATE WITH

INSTALL ALL WATER DISTRIBUTION PIPING PITCHED TO LOWEST POINT(S). INSTALL DRAIN VALVES AT LOW POINTS.

	CLEAN OUT SCH	EDULE						
TAG	CLEANOUTS							
IAO	DESCRIPTION	MA NUFACTURER/CATA LOG NUMBER						
FCO-1	HEAVY DUTY, A DJUSTA BLE PVC FLOOR CLEANOUT A SSEMBLY, ROUND TOP	ZURN; ZN1400						

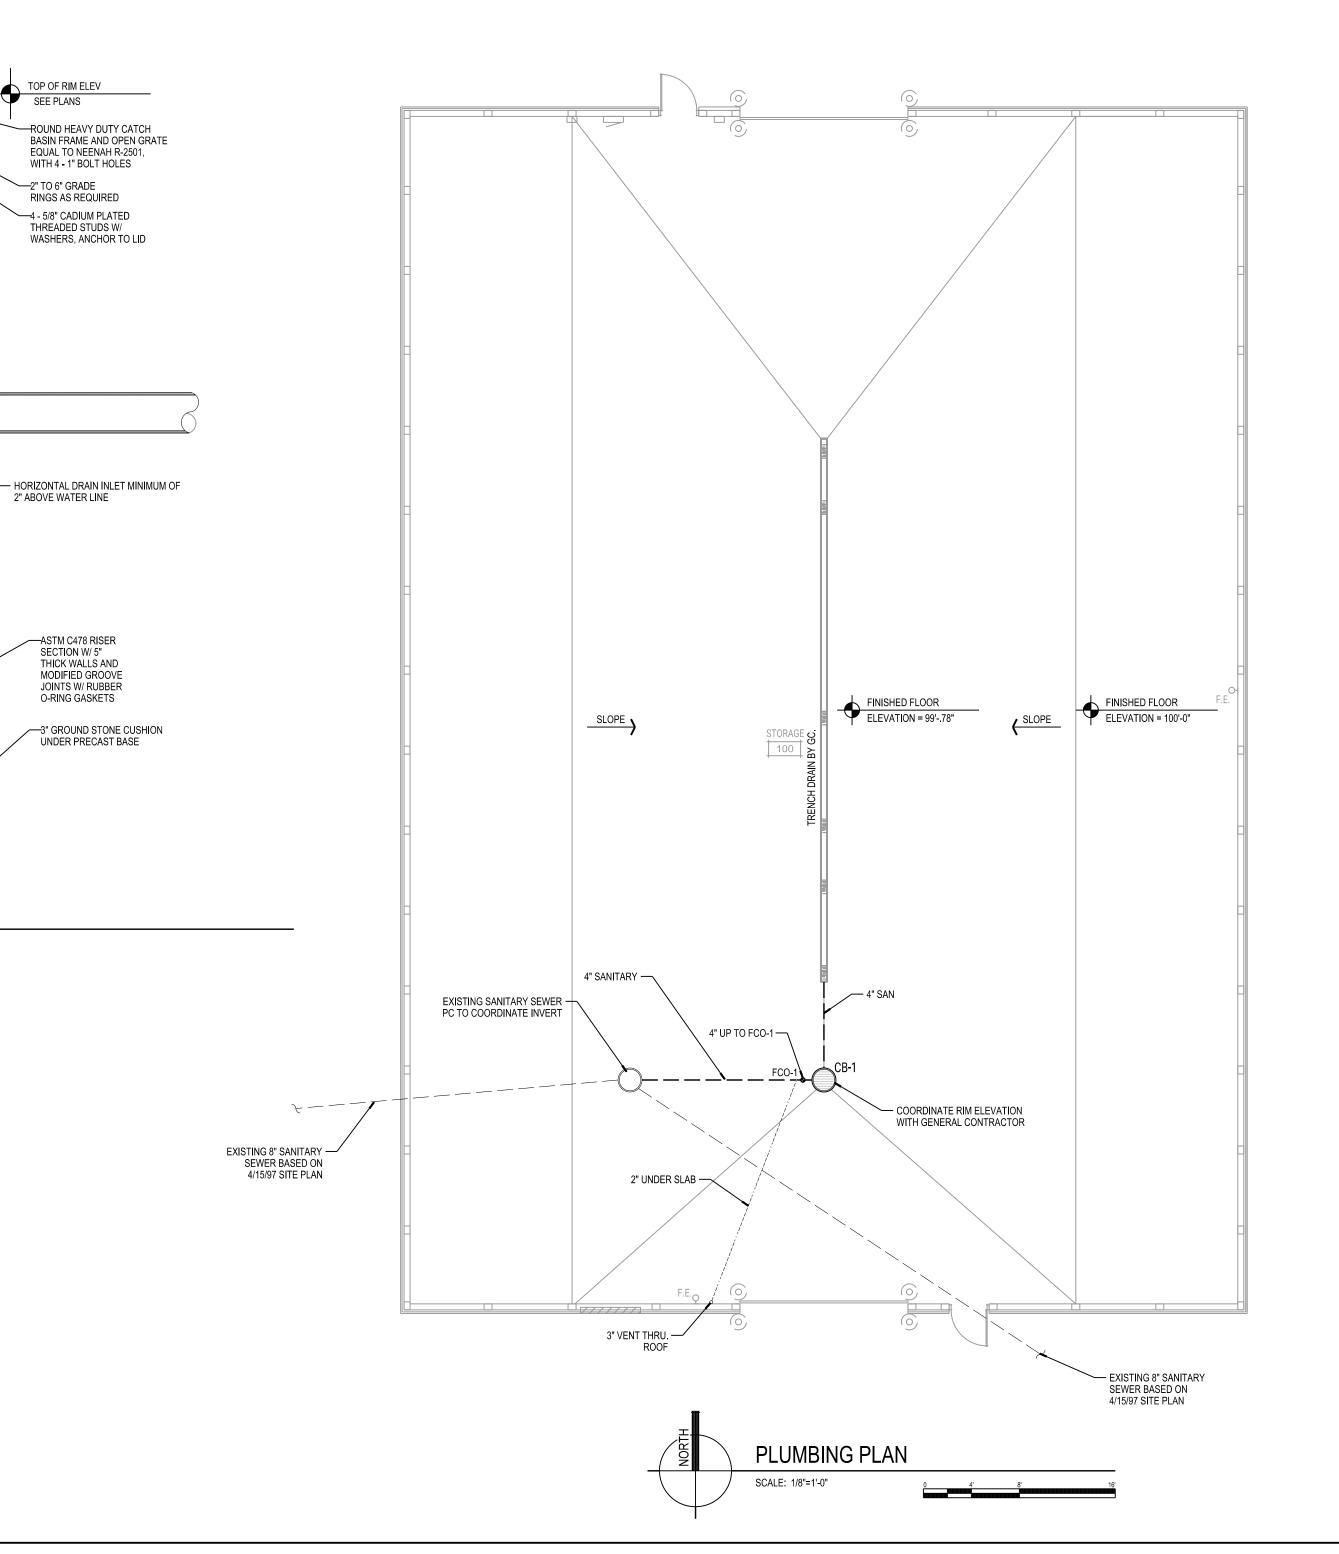




MARATHON COUNTY

SHERIFF'S DEPARTMENT STORAGE BUILDING

> 7015 PACKER DRIVE WAUSAU, WI 54401

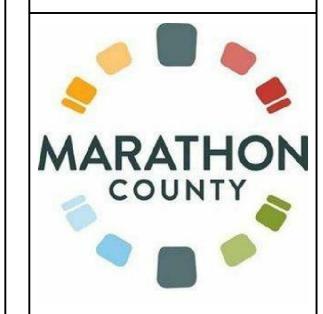

NO:	DESCRIPTION:	DATE:
1	Preliminary Floor Plan	20240111
2	Bid Review Set	20240129
3	Bidding / Construction	20240215
	99:17 PM	02/14/2024

No part of this drawing may be used or reproduced in any form or by any means, or stored in a database or retrieval system, without prior written permission of.

ANGUS - YOUNG ASSOCIATES, INC. Copyright © 2023 All Rights Reserved

> PROJECT NUMBER 77082

APPROVED BY

CAC

REVIEWED BY

DRAWN BY

MRM

PLUMBING PLAN & DETAILS

P101

E	KHAUST FAN SCHE	DULE										
TA	ROOM LOCATION	SYSTEM	CFM	SP	RPM	MOTOR H.P.	VOLTAGE @ 60HZ.	DRIVE	FAN TYPE	MANUFACTURER & MODEL NUMBER	CONTROL	
EF	-1 VEHICLE STORAGE	100 STORAGE	5125	0.7	829	1-1/2	208-1	BELT	CENTRIFUGAL	GREENHECK MODEL: CUBE-220	EXISTING TIME CLOCK & NEW CONTROLS	
NO	NOTE: FACTORY MOUNTED DISCONNECT SHALL BE PROVIDED. PROVIDE INTEGRAL BACKDRAFT DAMPER AT THE EXHAUST FAN.											

GENERAL NOTES

KEYNOTES

INSTALL THERMOSTATS/SENSORS NEXT TO AND AT SAME HEIGHT AS LIGHT SWITCHES, UNLESS NOTED OTHERWISE.

ACTUAL LOCATION OF GRILLES AND DIFFUSERS SHALL BE COORDINATED WITH REFLECTED CEILING PLAN. IF THERE ARE ANY DISCREPANCIES VERIFY FINAL LOCATION WITH ARCHITECT/ENGINEER.

3. OCCUPANCY SENSORS FOR VENTILATION CONTROL SHALL BE PROVIDED AND INSTALLED BY ELECTRICAL CONTRACTOR.

PROVIDE GAS PRESSURE REGULATOR TO REDUCE SUPPLY PRESSURE OF 2.0 PSI DOWN TO MANUFACTURERS RECOMMENDED PRESSURE.

MECHANICAL CONTRACTOR IS RESPONSIBLE FOR PROVIDING CORRECT QUANTITY OF GAS DETECTORS FOR FULL COVERAGE TYP.

EF-1 SHALL BE INTERLOCKED TO THE MOTORIZED DAMPER OF L-1 VIA NEW CONTROLS AND RELAYS AT THE EXISTING TIME CLOCK LOCATION. REFER TO THE CONTROLS SEQUENCE FOR ADDATIONAL INFORMATION.

MINIMUM VENTILATION: THE VENTILATION CONTROL SYSTEM SHALL ENGAGE THE EXHAUST FAN AND DAMPER ASSOCIATED WITH THE OSA AIR LOUVERS (L-1), DAILY FOR 5 HOURS.
TIME-OF-DAY OF THE ACTIVATION PERIODS SHALL BE PROGRAMMABLE FROM THE EXISTING

COMBUSTIBLES, THE SYSTEM SHALL ENGAGE EF-1 AND THE OSA DAMPER ASSOCIATED WITH L-1. THE VENTILATION SYSTEM MUST OPERATE AUTOMATICALLY UPON DETECTION OF NITROGEN DIOXIDE AT LEVELS OF ONE PART PER MILLION. DURING OPERATION A PILOT LIGHT LOCATED

ON THE PANEL SHALL ILLUMINATE INDICATING A CALL FOR STAGE ONE VENTILATION. STAGE

ONE VENTILATION SHALL BE DE-ENERGIZED WHEN CARBON MONOXIDE, NITROGEN DIOXIDE OF COMBUSTIBLES HAVE NOT BEEN DETECTED AT A LEVEL ONE CONCENTRATION FOR A

2. STAGE ONE VENTILATION: WHEN A LEVEL ONE CONCENTRATION OF CARBON MONOXIDE OR NITROGEN DIOXIDE IS DETECTED VIA THE GAS DETECTION SENSORS OR A 5% LEVEL OF

THE MECHANICAL CONTRACTOR SHALL PROVIDE AN INSULATED BACK AT THE THERMOSTAT.


4. ALL PIPING LOCATED IN WASH BAY SHALL BE GALVANIZED.

VEHICLE STORAGE CONTROL SEQUENCE

PROGRAMMED PERIOD OF TIME.

CEILING	CEILING (DESTRATIFICATION) FAN SCHEDULE												
TAG	ROOM	BLADE	CFM	WATTS	RPM	FULL LOAD	VOLTAGE	DRIVE	FAN	MA NUFA CTURER	CONTROL		
IAG	LOCATION	DIA.	CITIVI	VVATIS	KEWI	AMPS	@ 60HZ.	DINVL	TYPE	& MODEL NUMBER	CONTROL		
DF-1	100 STORAGE	56"	27,500	110	275	1	120-1	DIRECT	CENTRIFUGAL	LEADING EDGE	SPEED CONTROLER PROVIDED BY MANUFACTURE		
Dr-1	100 STORAGE	30	27,500	110	215	'	120-1	DIRECT	CENTRIFOGAL	MODEL 56001	INSTALLED BY CONTROLS CONTRACTOR		
DF-2	100 STORAGE	56"	27.500	110	275	1	120.1	DIDECT	CENTRIE! ICA I	LEADING EDGE	SPEED CONTROLER PROVIDED BY MANUFACTURE		
DF-2	100 STORAGE	50	27,500	110	2/5	1	120-1	DIRECT	CENTRIFUGAL	MODEL 56001	INSTALLED BY CONTROLS CONTRACTOR		

GAS-FIRED UNIT HEATER SCHEDULE

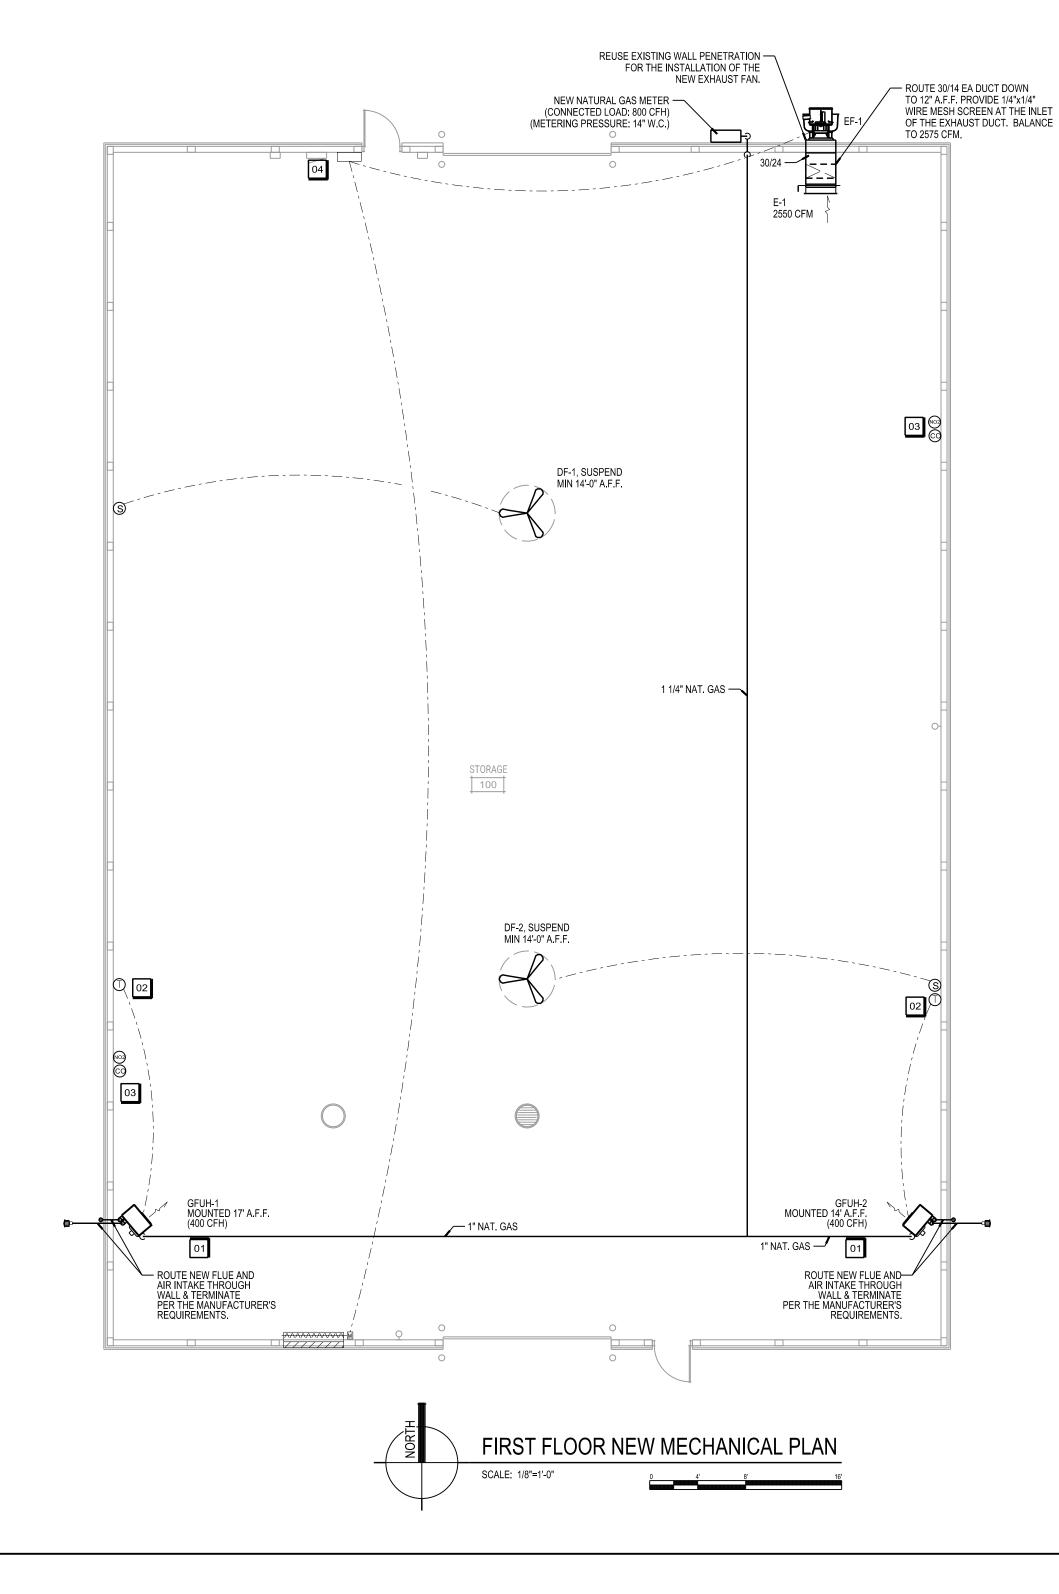



MODINE PTS400AS0111

MANUFACTURER

& MODEL NUMBER

TITUS MODEL 350RL

ISSUANCES / REVISIONS

No part of this drawing may be used or reproduced in any form or by any means, or stored in a database or retrieval system, without prior written permission of.


PROJECT NUMBER

CAC

DRAWN BY

SJG

MECHANICAL PLAN

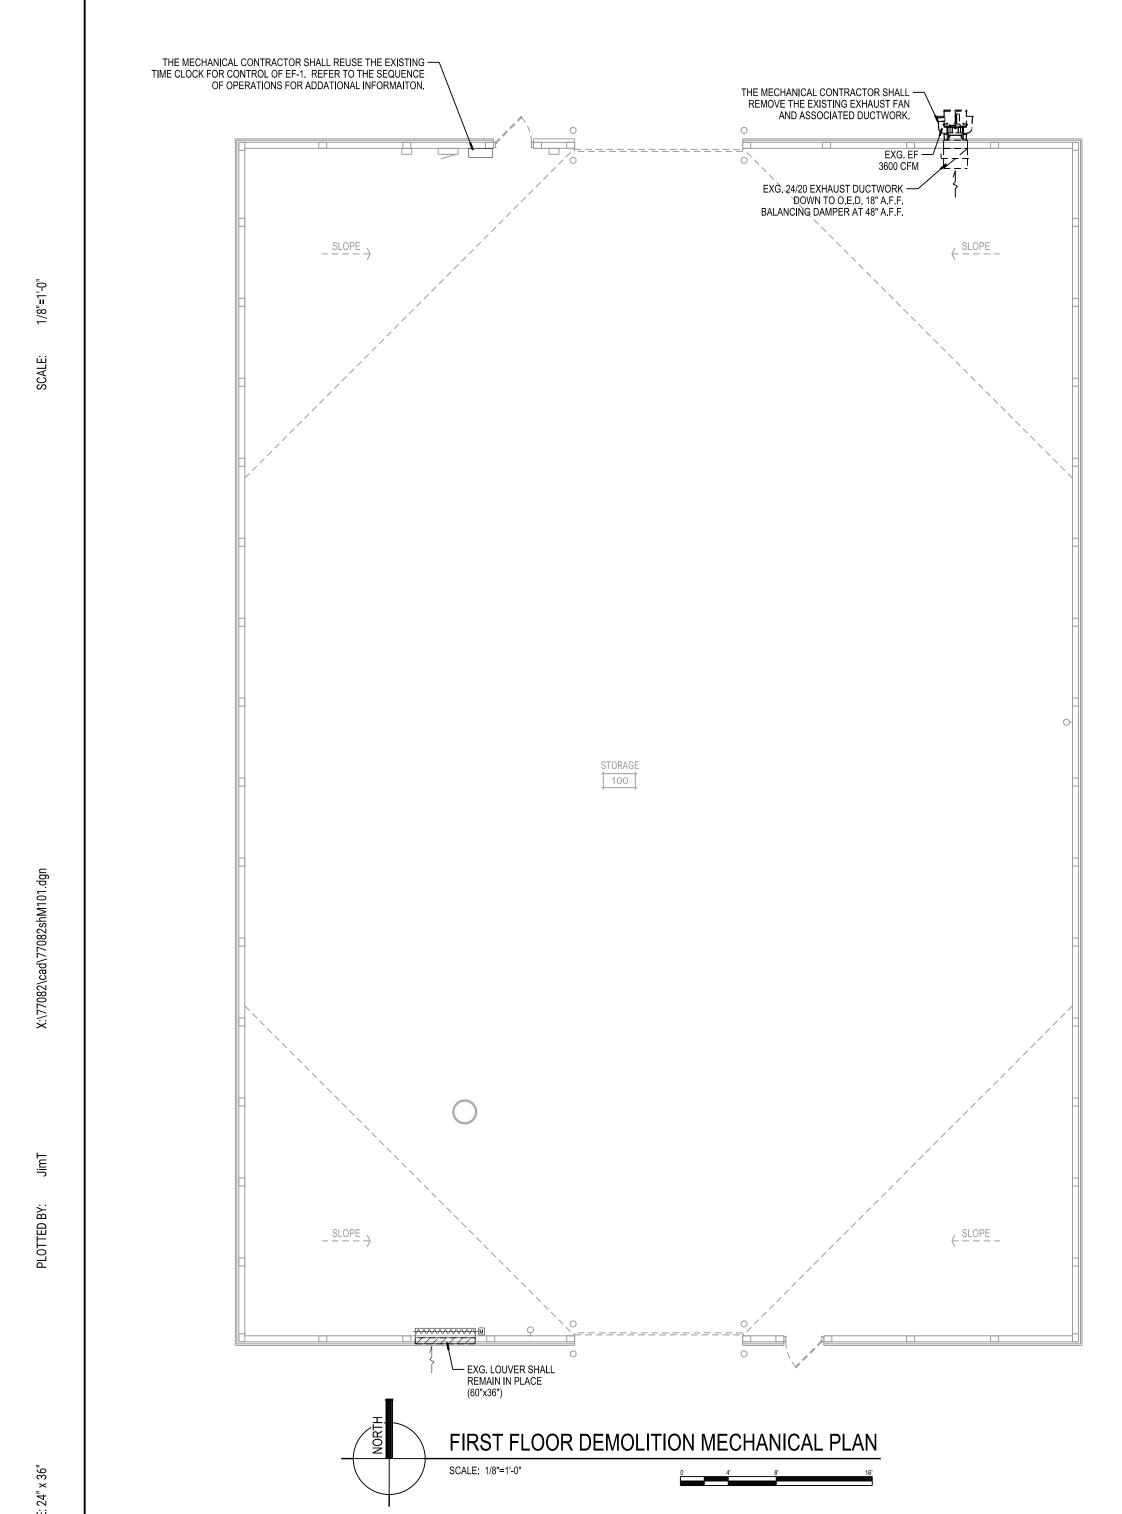



MARATHON COUNTY

SHERIFF'S DEPARTMENT STORAGE BUILDING

> 7015 PACKER DRIVE WAUSAU, WI 54401



	DESCRIPTION:	DATE:
	Preliminary Floor Plan	2024011
	Bid Review Set	2024012
	Bidding / Construction	202402
:39	9:16 PM 02/14/2024	1
	Due to electronic distribution, this drawin not be printed to the scale indicated on drawings. Do NOT use scale to determ dimensions or sizes.	the

ANGUS - YOUNG ASSOCIATES, INC.

Copyright © 2023 All Rights Reserved


77082


APPROVED BY

REVIEWED BY JCT

FIRST FLOOR NEW AND DEMOLITION

CALLOUT	SYMBOL	DESCRIPTION	LOCATION	VOLTS	AMPS	KVA	HP CIRCUIT	NOTE 1	NOTE 2	NOTE 3	DISCONNEC
DF-1	⊗ \$	DESTRATIFICATION FAN	STORAGE 100	120V 1P 2W	0.92	0.11	PANEL A-13	ELECTRICAL CONTRACTOR TO PROVIDE AND INSTALL TOGGLE SWITCH DISCONNECT.	PROVIDE 20A/1P CIRCUIT TO UNIT FROM PANEL A		TOGGLE SWITCH
DF-2	⊗ \$	DESTRATIFICATION FAN	STORAGE 100	120V 1P 2W	0.92	0.11	PANEL A-15	ELECTRICAL CONTRACTOR TO PROVIDE AND INSTALL TOGGLE SWITCH DISCONNECT.	PROVIDE 20A/1P CIRCUIT TO UNIT FROM PANEL A		TOGGLE SWITCH
EF-1	\odot	NEW EXHAUST FAN	STORAGE 100	208V 3P 3W	6.92	2.49	1.5 HP PANEL A-14,16,18	PROVIDE CONNECTION TO FACTORY MOUNTED DISCONNECT.			HARDWIRED CONNECTION
GFUH-1	⊗ \$	GAS-FIRED UNIT HEATER	STORAGE 100	120V 1P 2W	13.8	1.66	3/4 HP PANEL A-17	ELECTRICAL CONTRACTOR TO PROVIDE AND INSTALL TOGGLE SWITCH DISCONNECT.	PROVIDE 20A/1P CIRCUIT TO UNIT FROM PANEL A		TOGGLE SWITCH
GFUH-2	⊗ \$	GAS-FIRED UNIT HEATER	STORAGE 100	120V 1P 2W	13.8	1.66	3/4 HP PANEL A-19	ELECTRICAL CONTRACTOR TO PROVIDE AND INSTALL TOGGLE SWITCH DISCONNECT.	PROVIDE 20A/1P CIRCUIT TO UNIT FROM PANEL A		TOGGLE SWITCH

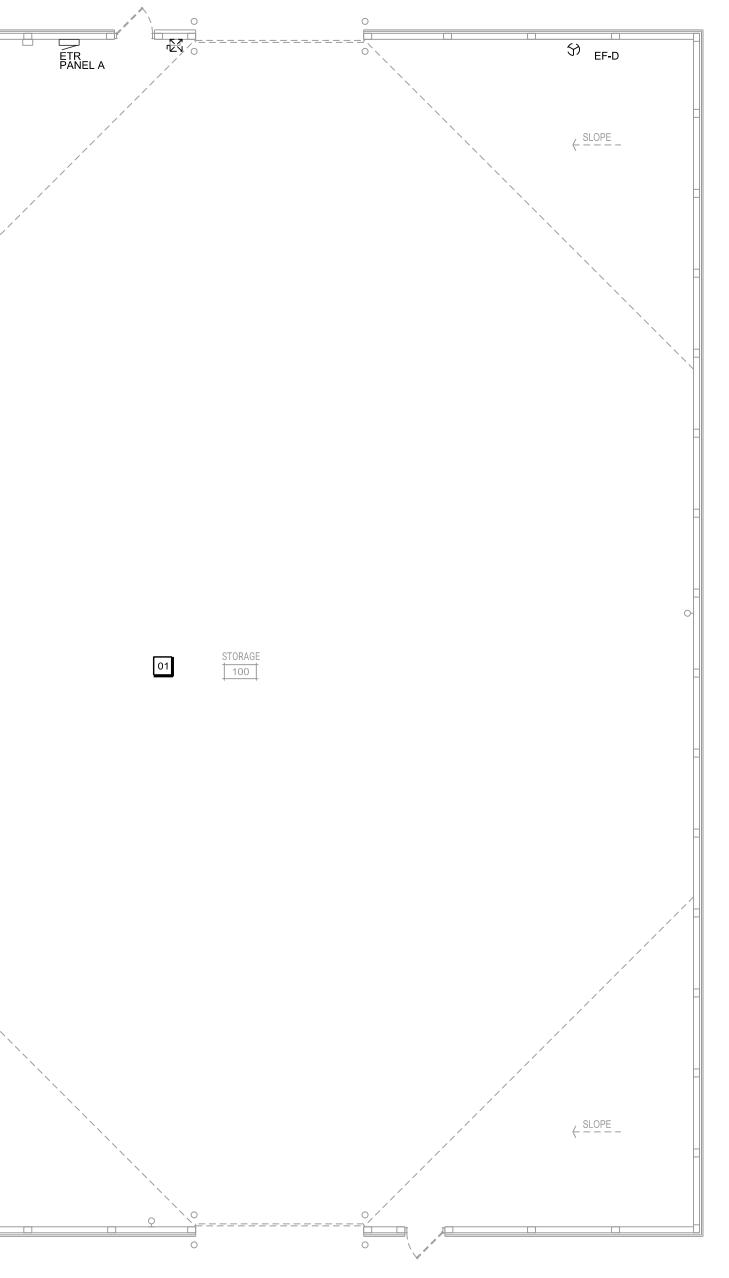

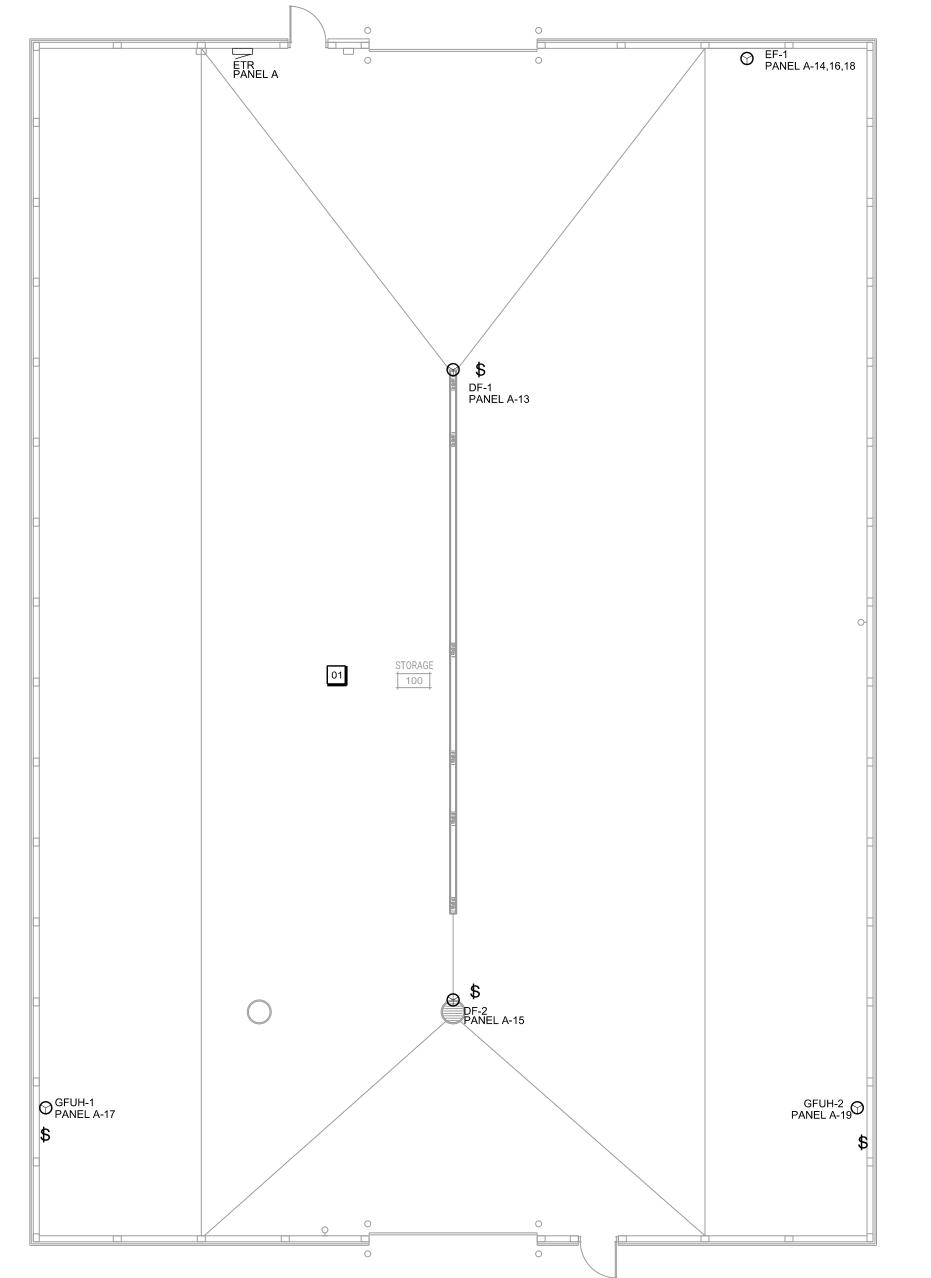

SCALE: 1/8"=1'-0"

F	PAI	٧E	LA					
RC	ОМ		VOLTS 208	Y/12	20V 3	BP 4W	AIC 22,000	
MC	UNTING	SURFAC	E BUS AMPS	20	0	MAIN BKR 200		
FE	D FROM	NEUTRAL	1009	%	LUGS STANDARD			
NC	TE							
СКТ	CKT	LOAD			СКТ	СКТ	LOAD	
#	BKR	KVA	CIRCUIT DESCRIPTION		#	BKR	KVA	CIRCUIT DESCRIPTION
1	20/1	0	PANEL RECPT.	а	2	20/1	0	WEST SIDE LIGHTS
3	20/1	0	RECPT. WEST WALL	b	4	20/1	0	EAST SIDE LIGHTS
5	20/1	0	RECPT. WEST WALL	c	6	20/1	0	OUTSIDE LIGHTS
7	20/1	0	RECPT. EAST WALL	а	8	20/1	0	TIME CLOCK & LOUVER POWE
9	20/1	0	RECPT. EAST WALL	b	10	20/1	0	NORTH DOOR OPENER
11	20/1	0	RECPT. EAST WALL CAMERAS	С	12	20/1	0	SOUTH DOOR OPENER
13	20/1	0.11	DF-1	a	14	20/3	2.49	 EF-1
15	20/1	0.11	DE-2	l_h	16			

j	9	20/1	0	RECPT. EA	ST WALL		b	10	20/1	0	NORTH DO	OR OPENER	
	11	20/1	0	RECPT. EA	ST WALL C	AMERAS	С	12	20/1	0	SOUTH DO	OR OPENER	
	13	20/1	0.11	DF-1			а	14	20/3	2.49	EF-1		
	15	20/1	0.11	DF-2			b	16					
	17	20/1	1.66	GFUH-1			c	18					
	19	20/1	1.66	GFUH-2			а	20	-/1	0	SPACE		
	21	-/1	0	SPACE			b	22	-/1	0	SPACE		
	23	-/ 1	0	SPACE			С	24	-/1	0	SPACE		
	25	-/ 1	0	SPACE			а	26	-/1	0	SPACE		
	27	-/ 1	0	SPACE			b	28	-/1	0	SPACE		
	29	- /1	0	SPACE			С	30	- /1	0	SPACE		
	31	-/ 1	0	SPACE			а	32	-/1	0	SPACE		
	33	- /1	0	SPACE			b	34	-/1	0	SPACE		
	35	- /1	0	SPACE			С	36	- /1	0	SPACE		
	37	-/1	0	SPACE			а	38	- /1	0	SPACE		
	39	-/1	0	SPACE			b	40	- /1	0	SPACE		
	41	-/ 1	0	SPACE			С	42	- /1	0	SPACE		
ı			CC	NN. KVA	CALC. KV	4				С	ONN. KVA	CALC. KVA	
	LIG	HTING	0		0	 (125%)	C	CONT	INUOUS		0	0	<u>(</u> 125%)
	LAF	RGEST MO	TOR 2	.49	3.12	(125%)	F	HEAT	ING		0	0	(100%)
	ОТ	HER MOTO	DRS 3	.53	3.53	(100%)	Ν	IONO	CONTINUO	US	0	0	(100%)

GENERAL NOTES

RECEPTACLES 0

THE BUILDING WILL REMAIN OCCUPIED AND IN USE DURING THE RENOVATION PROCESS. SCHEDULE THE WORK TO MINIMIZE DISRUPTION AND COORDINATE ANY NECESSARY DISRUPTIONS WITH THE OWNER.

(50%>10) KITCHEN EQUIP 0

PHASE BALANCE PERCENT: PHASE A 129% PHASE B 46.8% PHASE C 124%

NONCOIN/DIVERSE 0

BALANCED THREE PHASE AMPS 18.5

- THE INFORMATION SHOWN ON THESE DRAWINGS WAS OBTAINED FROM THE ORIGINAL CONSTRUCTION DRAWINGS WHERE AVAILABLE, AND FROM LIMITED FIELD REVIEW OF THE BUILDING AND SYSTEMS. PRIOR TO BIDDING, EACH CONTRACTOR SHALL INVESTIGATE THE EXISTING SYSTEM TO THE EXTENT NECESSARY TO ACCURATELY DETERMINE THE EXACT
- EXTENT OF THE REQUIRED WORK. THE CONTRACTOR'S BID PRICE SHALL INCLUDE THE RESOLUTION OF MINOR DISCREPANCIES AT NO COST TO THE OWNER. PRIOR TO THE START OF THE RENOVATION THE CONTRACTOR SHALL RE-VERIFY ALL EXISTING ELECTRICAL SYSTEMS AND SYSTEM COMPONENTS AND REPORT ANY SIGNIFICANT DISCREPANCIES FOUND TO THE A/E FOR RESOLUTION, ANY CONTROLLED EQUIPMENT OR COMPONENTS NOT NOTED IN THE PLANS OR SPECS BUT FOUND

PRIOR TO OR DURING COMPLETION OF THE NEW WORK SHALL ALSO BE REPORTED TO THE A/E.

- THE CONTRACTOR SHALL FIELD VERIFY ACTUAL LOCATION AND SIZE OF EXISTING BRANCH CIRCUIT WIRING, PANEL CAPACITY, CONDITION, AND BREAKERS.
- 5. CONTRACTOR SHALL PROTECT ALL WALLS, CEILINGS, FLOORS, LIGHTS AND OTHER FINISHED SURFACES. IF DAMAGED, CONTRACTOR SHALL REPAIR OR REPLACE TO MATCH EXISTING CONDITIONS AT NO ADDITIONAL COST TO THE OWNER. VERIFY LOCATIONS OF AND PROTECT
- EXISTING INTERIOR ELECTRICAL AND MECHANICAL UTILITIES AND SERVICES. ANY ELECTRICAL EQUIPMENT FOUND TO BE NON-FUCTIONAL OR IN NEED OF REPAIR OR MAINTENANCE WORK SHALL BE REPORTED TO THE A/E AND THE OWNER.
- ELECTRICAL CONTRACTOR TO CALCULATE VOLTAGE DROP OF ALL BRANCH CIRCUITS EXCEEDING 100' AND INCREASE CONDUCTOR AND GROUND SIZES AS REQUIRED TO MAINTAIN LESS THAN 5% COMBINED FEEDER/BRANCH VOLTAGE DROP AT THE FARTHEST LOAD.

DEMOLITION NOTES

- DEMOLITION OF AN ITEM SHALL INCLUDE REMOVAL OF ALL RELATED WIRING, HANGERS, SUPPORTS, CONDUIT, AND ACCESSORIES UNLESS NOTED OTHERWISE.
- 2. ALL MATERIALS & EQUIPMENT REQUIRING REMOVAL AND RELOCATION FOR REUSE SHALL BE CAREFULLY REMOVED AND STORED TO PREVENT DAMAGE AND SHALL BE REINSTALLED AS
- 3. ALL MATERIALS AND EQUIPMENT REMOVED AND NOT REUSED SHALL BECOME THE PROPERTY OF THE CONTRACTOR AND SHALL BE REMOVED FROM THE SITE UNLESS NOTED OTHERWISE. THE OWNER RESERVES THE RIGHT TO SALVAGE PARTS FROM ANY ELECTRICAL EQUIPMENT BEFORE REMOVAL FROM THE SITE.
- 4. VERIFY CONDITION OF EXISTING CIRCUIT WIRING AND RACEWAYS. REUSE EXISTING CIRCUIT

5. LABEL "D" INDICATES DISCONNECT AND REMOVE, LABEL "ETR" INDICATES EXISTING TO REMAIN.

WIRING AND RACEWAY FOR NEW CIRCUITS SHOWN ON PLANS. EXTEND AS NECESSARY.

KEYNOTES

EXISTING LIGHT FIXTURES TO BE DISCONNECTED AND REINSTALLED ON NEW CEILING. COORDINATE WITH GENERAL CONTRACTOR.

ANGUS-YOUNG ARCHITECTS/ENGINEERS Janesville | Madison

> MARATHON COUNTY

SHERIFF'S DEPARTMENT STORAGE BUILDING

> 7015 PACKER DRIVE WAUSAU, WI 54401



ISSUANCES / REVISIONS NO: DESCRIPTION: 20240215 Bidding / Construction

Due to electronic distribution, this drawing may not be printed to the scale indicated on the drawings. Do NOT use scale to determine dimensions or sizes.

No part of this drawing may be used or reproduced in any form or by any means, or stored in a database or retrieval system, without prior written permission of.

ANGUS - YOUNG ASSOCIATES, INC. Copyright © 2023 All Rights Reserved

PROJECT NUMBER

77082

APPROVED BY


CAC

REVIEWED BY

DRAWN BY

FIRST FLOOR NEW AND DEMOLITION

ELECTRICAL PLAN

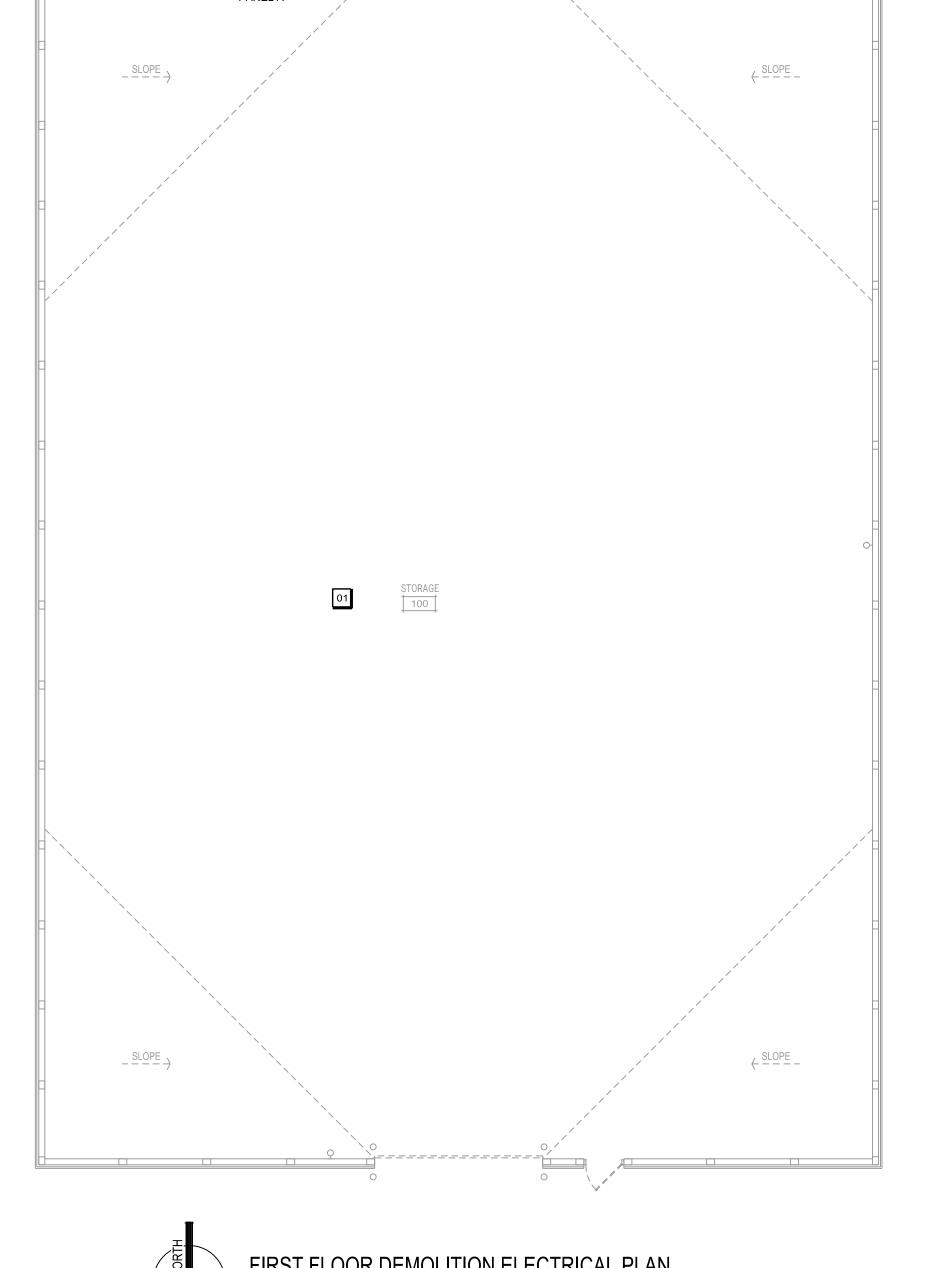

SCALE: 1/8"=1'-0"